



# ERVMAX RETROFIT CASE STUDY



## Global Energy Group Corporate Office Odessa, FL

- Completed in August, 2002
- One 6-ton ERVMAX unit
- Capacity increase of 25%
- Efficiency increase of 41%

One 6-ton Trane, TWA series, split system was retrofitted with a 6-ton ERVMAX unit. This unit served office space occupied Monday through Friday from 7am to 7pm, and demanded an indoor ambient of 75°F. Performance of the retrofitted system was compared to the operation of an identical split system without modifications. A capacity increase of 25% was realized using 100% outdoor air. The system EER increased from 9.1 to 12.8.

### Project Reference:

Tom Hebert  
V.P. of Research & Development  
Global Energy Group, Inc.  
(727) 372-3939

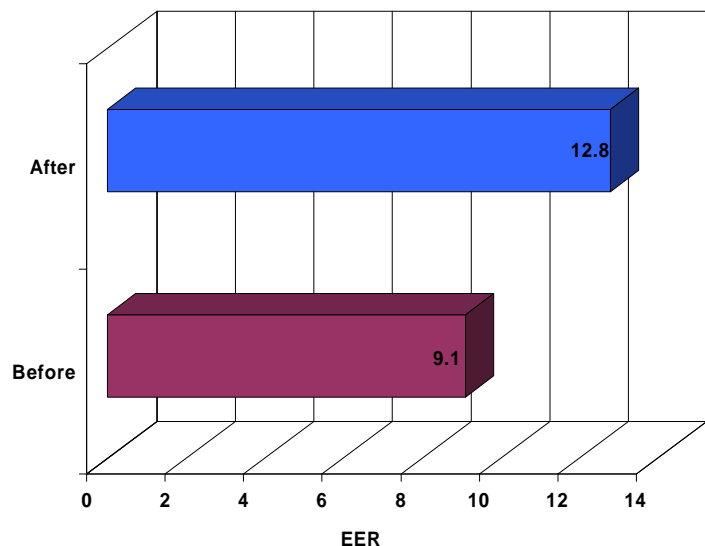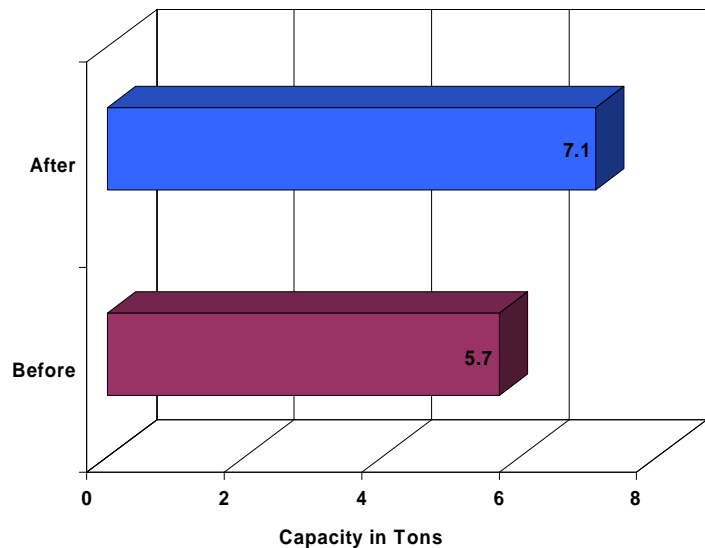

Olive Tree Energy LLC

936 east 124th Ave., Suite C;

Tampa, Florida, 33612; Ph: 813-978-3733

E-mail: [info@olivetreeenergy.com](mailto:info@olivetreeenergy.com) Website: [www.olivetreeenergy.com](http://www.olivetreeenergy.com)